

June 2023

Si desea más información
acerca este proyecto en
español, por favor llame al
402.554.6666



WATER INFRASTRUCTURE REPLACEMENT

This project may require the replacement of your water service line and meter to your home – all at no cost to you.

WHY

- Investing in your neighborhood by improving the integrity and reliability of the water system.
- To continue providing you with safe, reliable tap water by maintaining our water system as efficiently and cost-effectively as possible.
- Part of M.U.D.'s Infrastructure Replacement Program.

WHEN AND HOW LONG

Work will begin soon and continue over the next few months, barring any unplanned delays.

PROCESS USED = PIPE BURSTING

- M.U.D. utilizes pipe bursting which involves fracturing the existing cast iron main in place and simultaneously pulling new HDPE pipe into the existing underground water main. This process is faster and safer construction.
- Requires the existing water main be taken out of service.

WATER SERVICE INTERRUPTION(S)

During the project, you may experience a temporary water service interruption lasting four hours or less and will be notified prior to any planned interruption.

TO PREPARE FOR A WATER INTERRUPTION

To continue using a tank-style toilet, fill containers with water and have a bucket nearby to scoop water into the toilet tank and fill about halfway **for each flush**.

Fill containers with water and keep on hand during the interruption to allow for handwashing and drinking.

AFTER A WATER INTERRUPTION

It is normal for air to be in the water lines after a water interruption; please run your COLD water for about 10 minutes to release the air.

WHAT YOU MAY EXPERIENCE

PRELIMINARY WORK installation of temporary water service

- To provide water service during this project, a *temporary* water service will be installed for each home or business near the existing water service tap.
- Temporary 2-inch piping will be installed along the ground on the side of the street where the current water main exists.
- Affected driveways will continue to have access by use of a temporary ramp that will be put in place.
- While the temporary water service is being installed, you may experience some minor service interruptions. An interruption could last one half hour or less.
- You will be notified prior to any planned interruption(s).

DURING THE PROJECT

- Fire protection will be provided by nearby in-service hydrants and the fire department has been made aware of the work.
- Temporary traffic lane restrictions – for the safety of you and all crews, please slow down when driving in the area.
- Streets, sidewalks, lawns, and landscaping may be affected; however, all will be restored as weather permits.
- A series of large excavation pits to access the existing water main will be necessary.
- Trucks and equipment, water pipe, safety fence and cones will be seen throughout the project area.
- After the water main replacement work is complete, the temporary water system will be dismantled.
- M.U.D. will administer water quality and pressure tests throughout the project to ensure your water is safe and reliable.



Hydrants are generally in easement or Right of Way (ROW) and may be moved to accommodate the new main and meet all fire codes.

QUESTIONS / CONCERNS



Email customersuccessteam@mudnebr.com
Call Tina Gutschenritter 402.504.7770

FOR MORE INFO.

www.mudomaha.com/IR

SCAN FOR MORE INFO. ON PIPE BURSTING



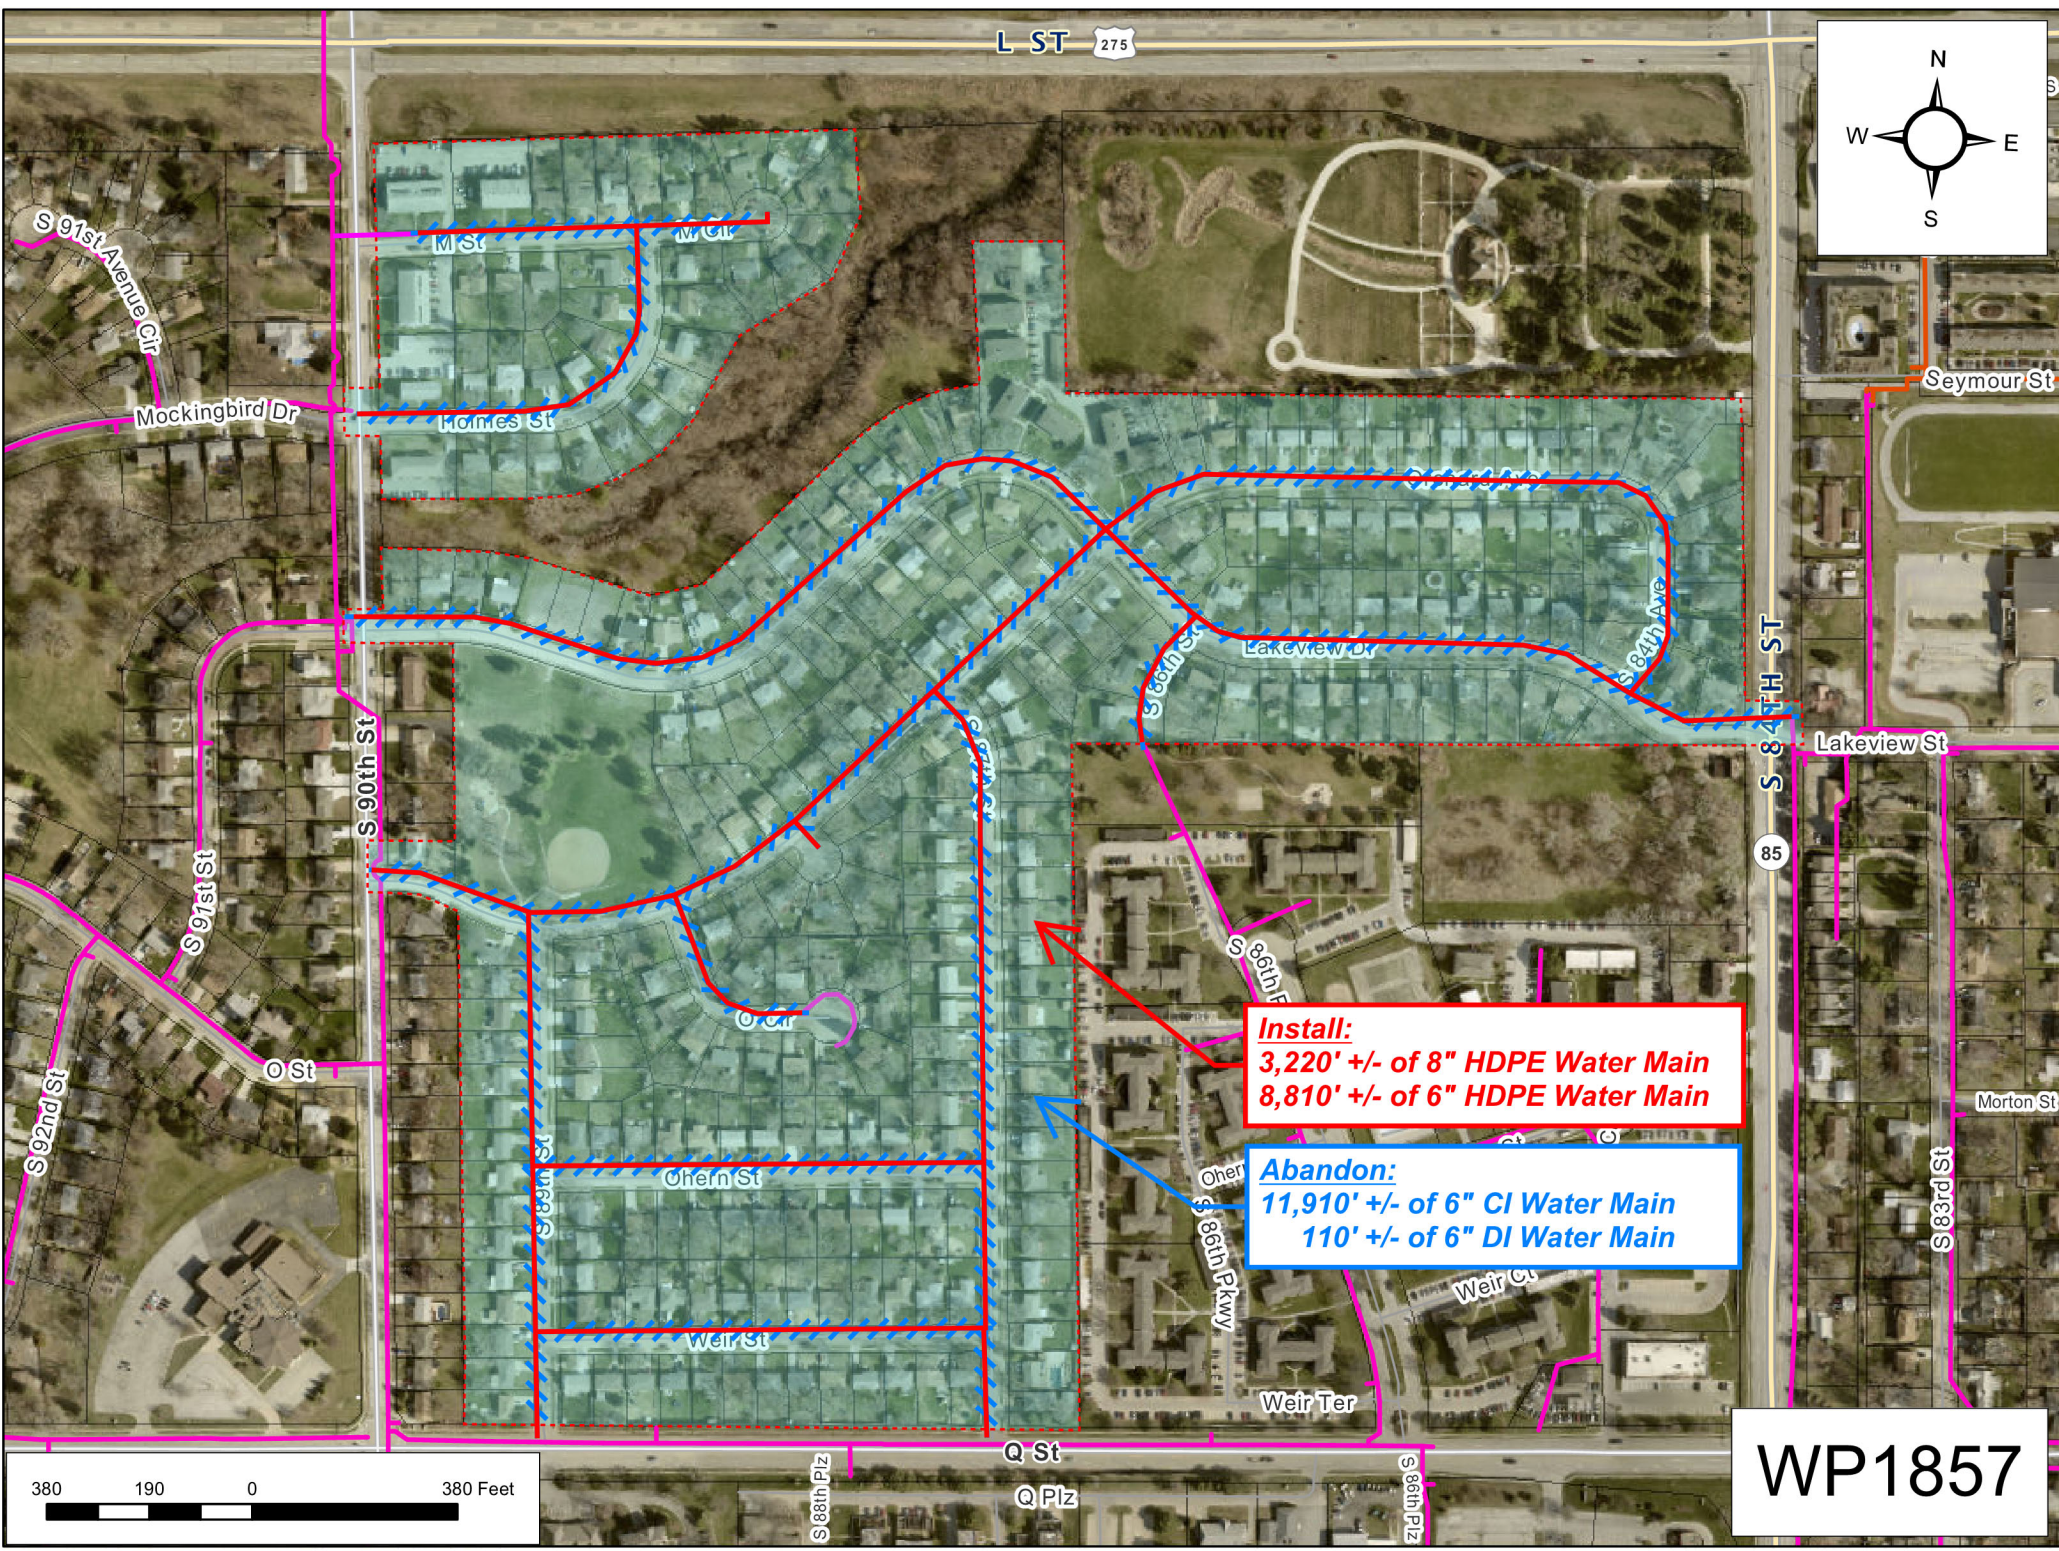

Install:
3,220' +/- of 8" HDPE Water Main
8,810' +/- of 6" HDPE Water Main

Abandon:
11,910' +/- of 6" CI Water Main
110' +/- of 6" DI Water Main



WP1857