


M.U.D. Lead Service Line Replacement Program

Agenda

1. Introductions
2. Lead Water Service Overview
3. Funding
4. Public Outreach
5. Project Communication


What is a Water Service?

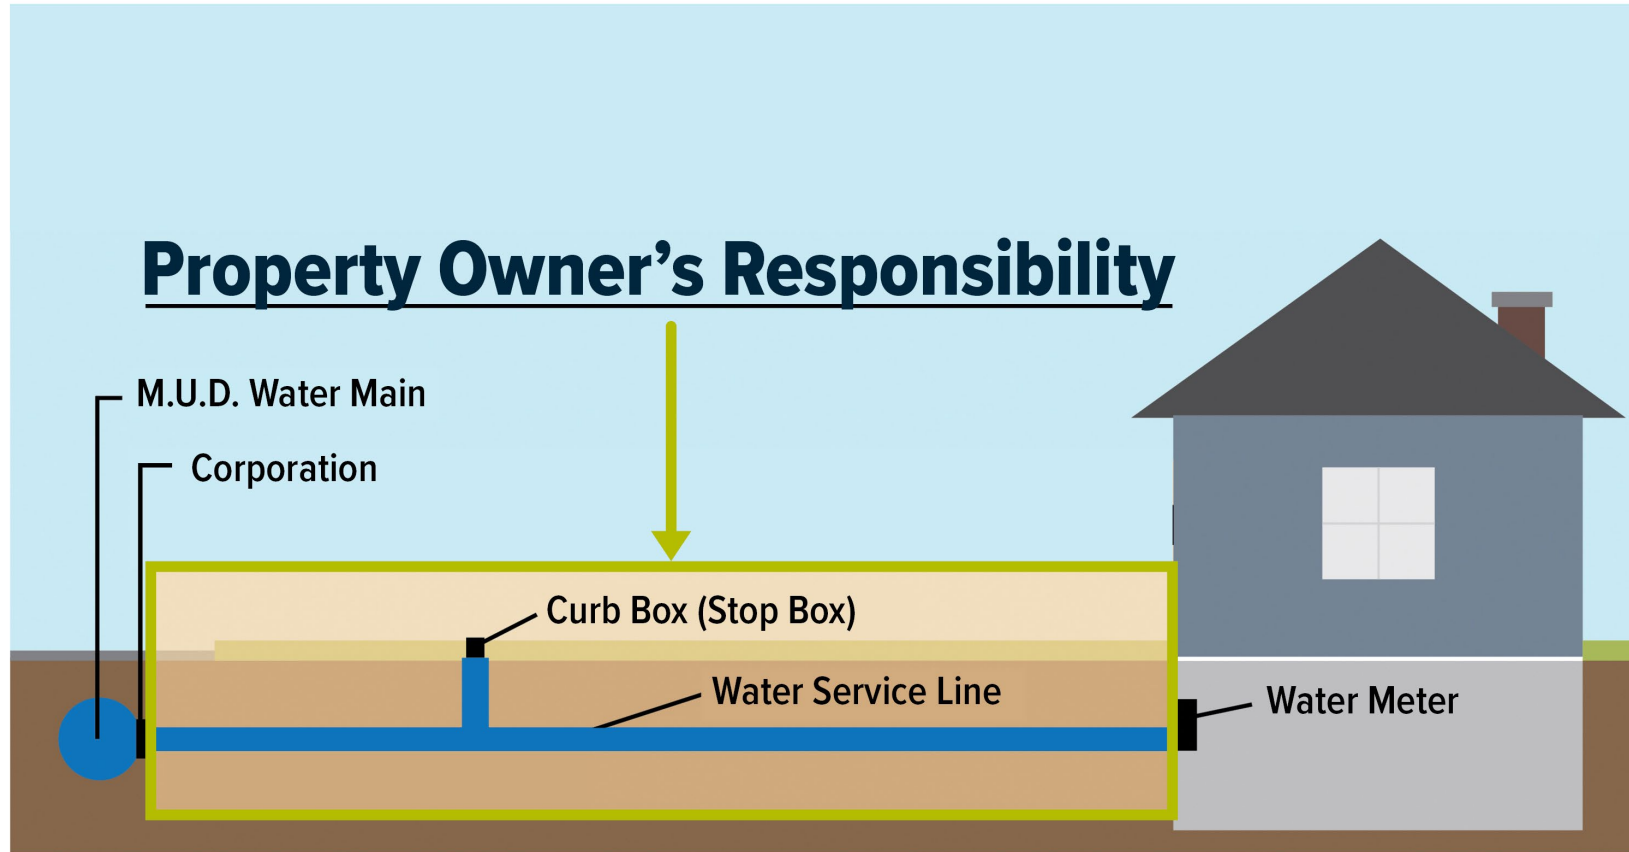

Program Cost

16,000 services
x \$8,000 per
replacement
x inflation =
\$157 Million

Where are Lead Service Lines?

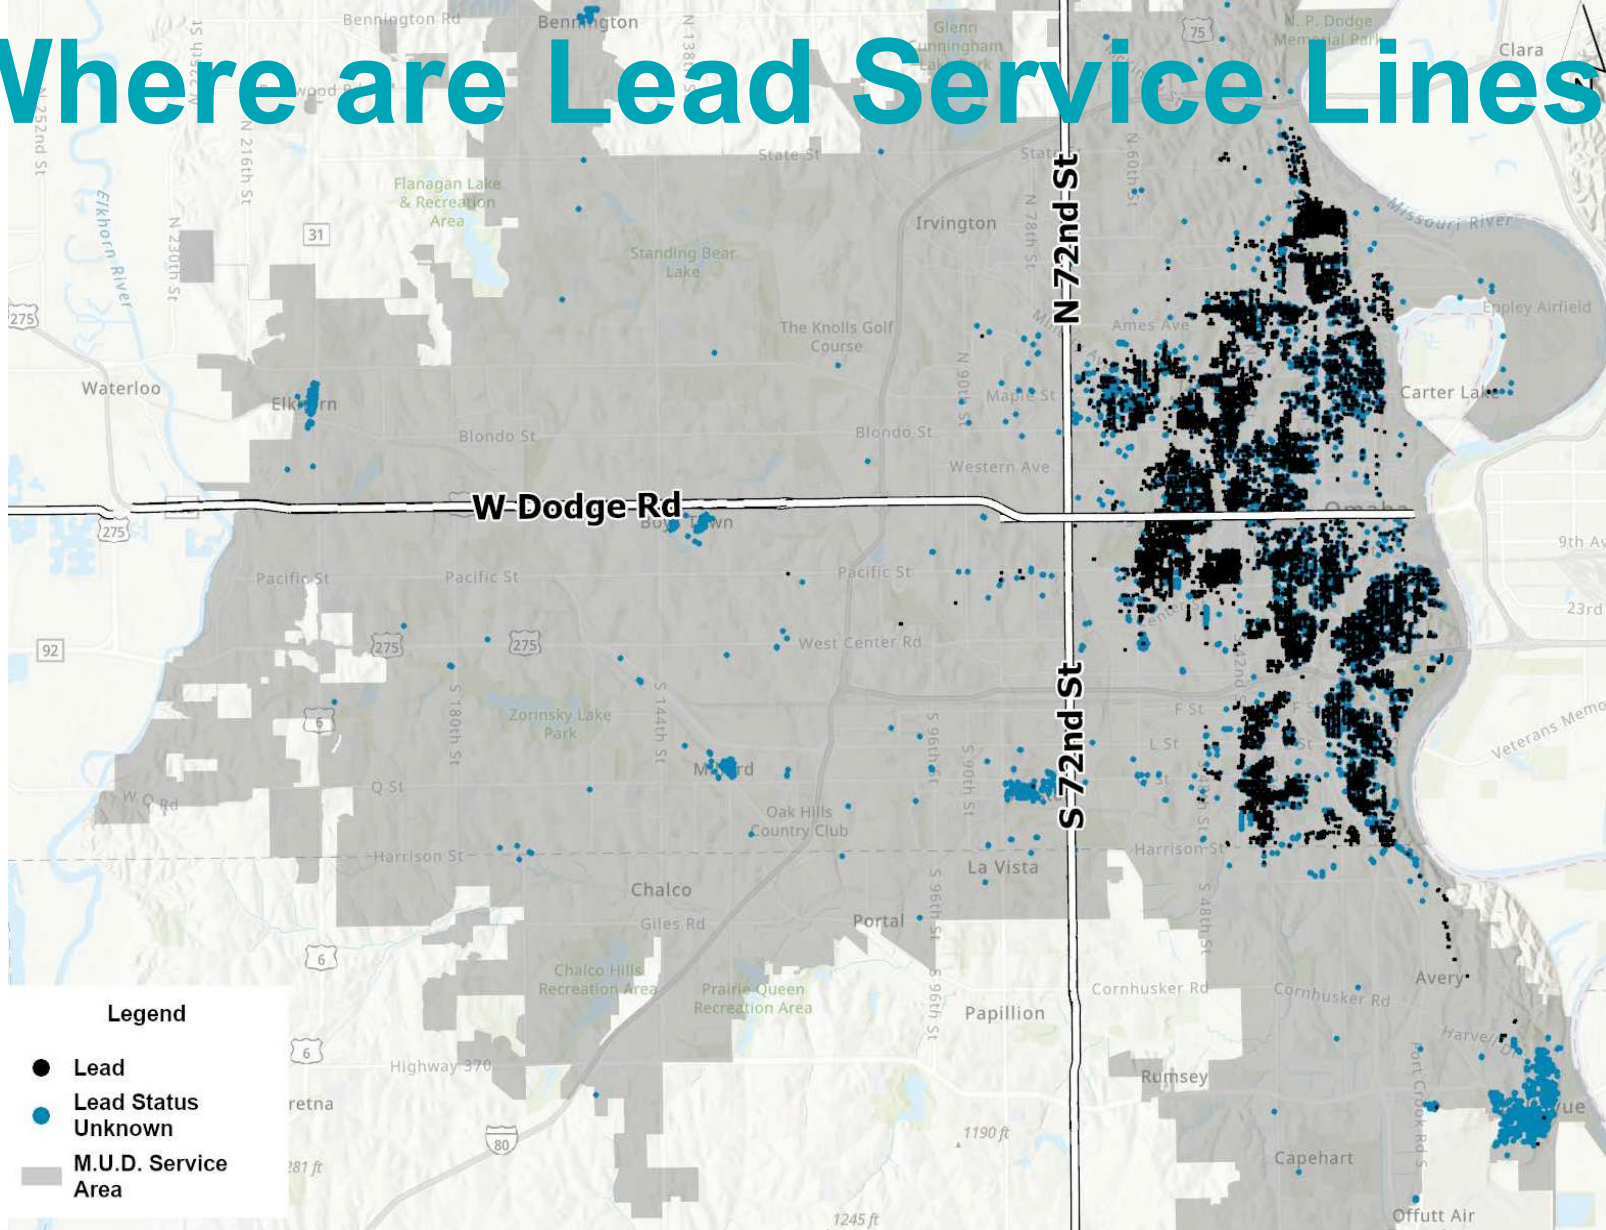

HYPERTACTIVITY
LEARNING DISABILITIES
HEALTH PROBLEMS
BEHAVIORAL DISORDERS

CHILDHOOD LEAD POISONING

CRIME IN ADULTHOOD
**REDUCED INTELLIGENCE/
LOWER IQ SCORES**
CHILDHOOD DELINQUENCY
SPEECH DISORDERS

ACADEMIC FAILURE
**LEARNING
DIFFICULTIES**
**LACK OF
EMPLOYMENT**

COST TO CHILD'S FUTURE

**LIFE-LONG
HEALTH PROBLEMS**
CRIMINAL RECORD
**SOCIALIZATION
PROBLEMS**

HEALTHCARE
JOBLESSNESS

COSTS TO SOCIETY

SPECIAL EDUCATION
JUVENILE JUSTICE

Water Quality

M.U.D. meets or exceeds all state and federal standards.

- Lead is not present in our raw water, the finished water that leaves our plants, or in the water mains
- Plumbing materials
- Non-corrosive water to prevent leaching



Funding

Appropriations


1. \$10 million – LB 814 and 818 via State Senator McDonnell
2. \$4 million – Federal appropriation via Senator Fischer
3. No dollars designated currently – Pursuing Department of Economic Development North and South Omaha Grant Program
4. \$40 million – Drinking Water State Revolving Fund (DWSRF) – M.U.D. seeking a DWSRF loan which includes partial loan forgiveness.



Community Outreach

- **Community meetings**
- **Neighborhood associations**
- **Public events**

Website

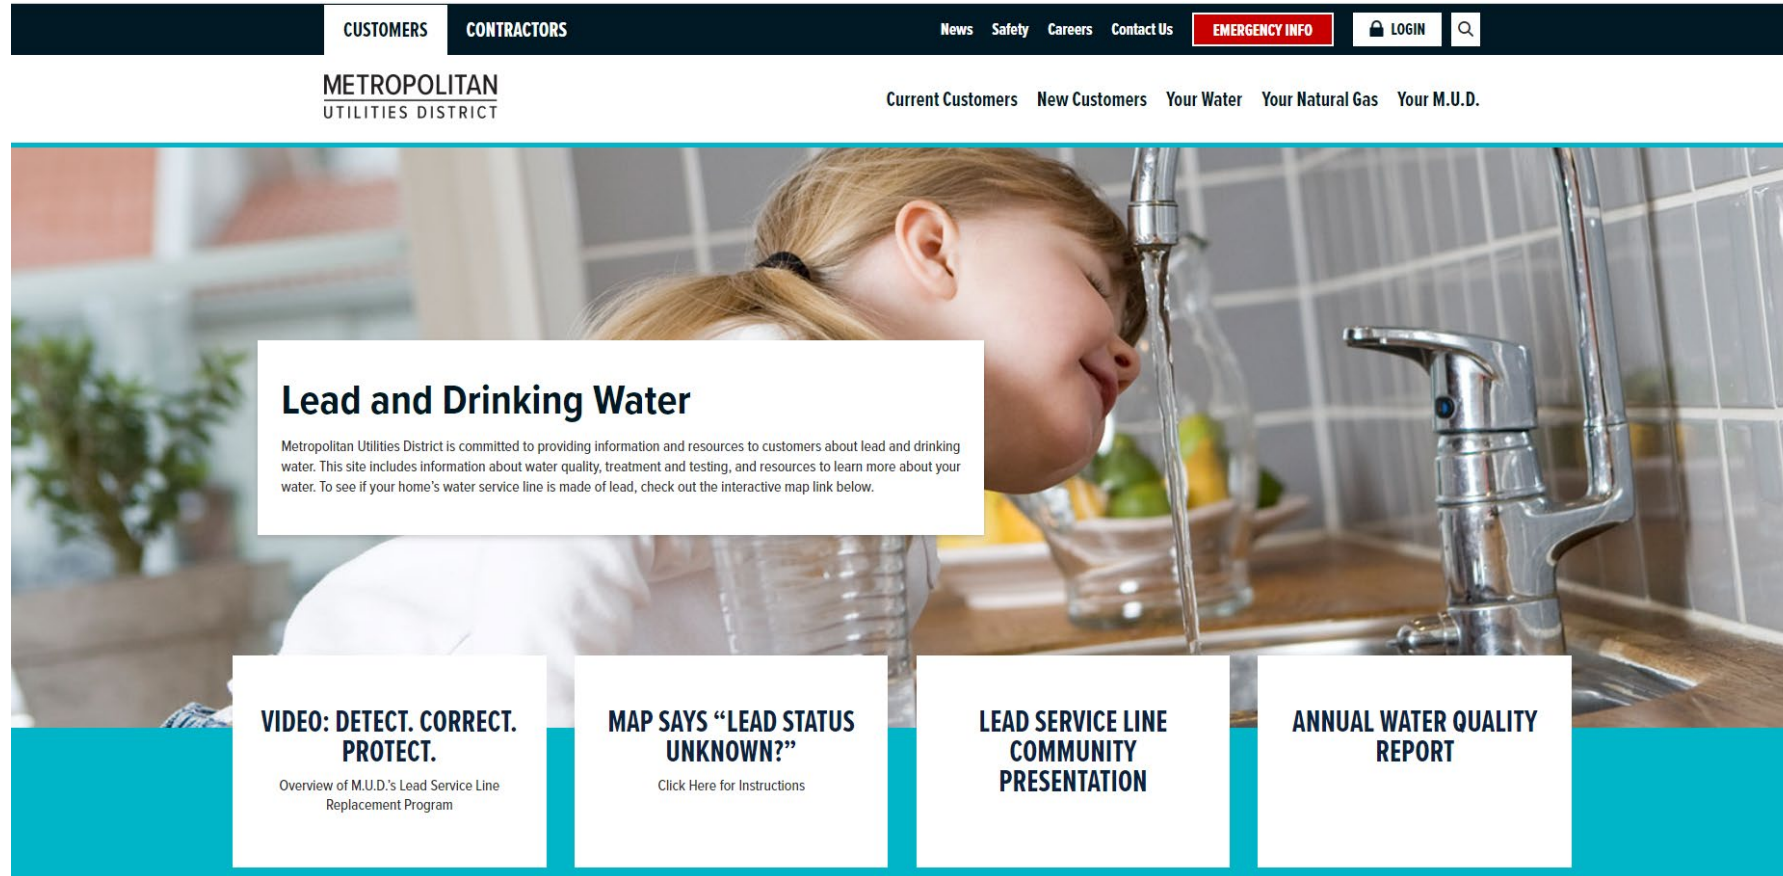



1234 Potter St

Search result

1234 Potter St, Omaha, Nebraska 68122

Legend

Category

Material Type

- Lead
- Galvanized requiring replacement
- Lead Status Unknown
- Non-Lead
- Non-Lead - Material Unknown

Zoom to

1234 Potter St

Confirmed lead service line requiring replacement.

Based on your property's construction date and available records, it is confirmed that your service line contains lead, therefore you are part of our Detect. Correct. Protect - Lead Service Line Replacement Program. M.U.D. will communicate with customers before work begins in your area and throughout the replacement process. Please click here to ensure M.U.D. has your current contact information. If you have additional questions, please call Customer Service at 402.554.6666 or email us at lead@mudnebr.com. run

Interactive Map

Project Communications

Public

- Medical facilities
- Schools
- Daycares
- Health Department

Customer

- Annual notification
- Project notices
- Testing

Education

FREE WATER TESTING

Ensayos o Pruebas de Agua Gratuitas

DETECT. CORRECT. PROTECT.
DETECTAR. CORREGIR. PROTEGER.

Lead Service Line Replacement Program

PROGRAMA DE ACTUALIZACIÓN O REEMPLAZO DE LA LÍNEA DE SERVICIO DE AGUA.

METROPOLITAN
UTILITIES DISTRICT



Detect. Correct. Protect.

Lead Service Line Replacement Program

IMPORTANT:
Please Read Enclosed Information

Vea el reverso para español

METROPOLITAN
UTILITIES DISTRICT

Detectar. Corregir. Proteger.

Programa de Actualización o Reemplazo de la Línea de Servicio de Agua.

IMPORTANTE:
Por favor lea la Información Adjunta

METROPOLITAN
UTILITIES DISTRICT

Detect. Correct. Protect.

Lead Service Line Replacement Program

 mudomaha.com/lead

METROPOLITAN
UTILITIES DISTRICT

M.U.D. Lead Service Line Replacement Program



Metropolitan Utilities District
136 subscribers

Subscribe



0



Share



Download

Save



Questions?

**DETECT.
CORRECT.
PROTECT.**

LEAD SERVICE LINE
REPLACEMENT PROGRAM

 mudomaha.com/lead

 lead@mudnebr.com

 402.504.7029

**LEADING THE WAY,
ONE SERVICE LINE AT A TIME.**

METROPOLITAN
UTILITIES DISTRICT